

Study on the Influence of Grid Voltage Quality on SVG and the Suppression

Renjie Hu*, Guiping Yi, Wei Jiang, Huichun Huang

School of Electrical Engineering, Southeast University,
No.2, Sipai Lou, Xuanwu District, 210096 Nanjing, China

*Corresponding author, e-mail: huenjie@seu.edu.cn

Abstract

Industrial Static Var Generator (SVG) is typically applied at or near the load center to mitigate voltage fluctuation, flicker, phase unbalance, non-sine distortion or other load-related disturbance. Special attention is paid to the influence of grid voltage quality on SVG current, the non-sine distortion and unbalance of grid voltage causes not only the AC current distortion and unbalance but also the DC voltage fluctuation. In order to let the inverter voltage contain the fundamental negative sequence and harmonic component corresponding to the grid voltage, a new dual-loop control scheme is proposed to suppress the influence in this paper. The harmonic and negative sequence voltage decomposition algorithm and DC voltage control are also introduced. All these analyses can guide the practical applications. The simulation results verify the feasibility and effectiveness of the present control strategy and analyses.

Keywords: SVG, unbalance, harmonic, distortion, dual-loop control

Copyright © 2014 Institute of Advanced Engineering and Science. All rights reserved.

1. Introduction

With the fast development of information technology in recent years, the requirement for electricity quality is higher and higher. In addition to require the reliability and continuity of power supply system, stable voltage and frequency are also expected. But the loads of distribution network are increasing, such as rectifier, arc furnace and so on. The nonlinear, impulse and imbalance characteristics of these loads result in distortion of the voltage and current waveforms, voltage fluctuations and flicker. Lightning, short circuit and open circuit in power system can also cause severe disruption to electricity quality. The supply cutting off suddenly will bring enormous economy loss, especially in significant industry. Therefore how to enhance and ensure power quality has been a major topic in the electrical engineering [1].

Static Var Generator (SVG) is an advanced reactive power compensator and it has attracted more and more attentions in recent years. It can be used to control power factor, regulate voltage, stabilize power flow and improve dynamic performance of power systems. SVG can also provide additional functions like harmonics compensator and load balancer, as a potential trend in the past decade. The major advantages of a SVG include faster dynamic response, the ability to generate the rated current at almost any grid voltage, the use of relatively small capacitor on the dc side and a smaller footprint in a substation [2, 3].

In this paper we concentrate on SVG operation with non-ideal grid voltage, which include unbalanced and harmonic components. As a consequence of unbalanced conditions, large negative sequence current may flow between the compensator and the grid. Harmonic current may flow between the compensator and the grid under harmonic voltages conditions. Unbalanced and harmonic voltages in the grid cause voltage distortion on the dc side and consecutively the generation of low order harmonics on the ac side. Under the effect of the control strategy, the negative sequence and harmonic currents of SVG are controlled to zero and there is no low-order harmonics generation on the ac side.

2. Impact of Non-ideal Grid Voltage on DC Voltage

The proposed configuration of the whole system is shown in Figure 1. There is no transformer, and the SVG is directly connected in parallel with the three-phase load via a small inductor for attenuation of switching frequency current ripples. The power converter of the SVG

employs several series-connected IGBTs in each leg of the three-phase bridge circuit for medium voltage blocking capability. The DC capacitors could be in series and parallel connections too. The SVG looks like a voltage source. When the system voltage U includes negative sequence voltage and harmonic voltage, negative sequence current and harmonic current can flow into the compensator limited only by the SVG reactance X , the value of harmonic current can be calculated by Equation (2) [4-6].

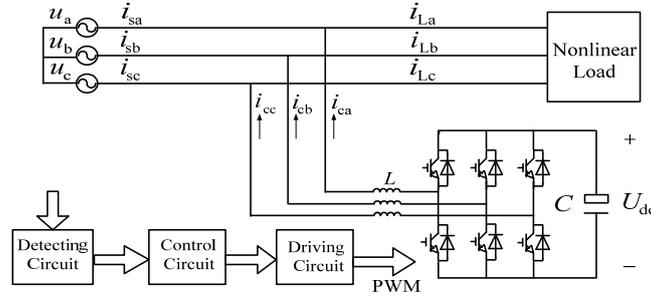


Figure 1. Structure of SVG

2.1. Impact of Grid Harmonic Voltage

Harmonic voltage content can be derived as follows:

$$HRU_n = \frac{U_n}{U_1} \times 100\% \quad (1)$$

Where U_n is the rms value of n-order harmonic voltage, U_1 is the rms value of fundamental positive sequence voltage. When the harmonic voltage content is HRU_n , the harmonic current flowing through the SVG is expressed [1]:

$$I_n = \frac{U_n}{X_n} = \frac{U_1 HRU_n}{\sqrt{R^2 + (n\omega_0 L)^2}} = \frac{U_1}{\sqrt{R^2 + (\omega_0 L)^2}} \quad (2)$$

Assumed that φ_1 is the phase angle of the fundamental positive sequence current. The harmonic current flowing through the SVG is expressed.

$$\begin{bmatrix} i_{an} \\ i_{bn} \\ i_{cn} \end{bmatrix} = -I_n \begin{bmatrix} \cos(n\omega_0 t + \varphi_1) \\ \cos(n\omega_0 t + \varphi_1 + 120^\circ) \\ \cos(n\omega_0 t + \varphi_1 - 120^\circ) \end{bmatrix} \quad (3)$$

By considering only the fundamental components, the switching function of the SVG converter can be simplified.

$$\begin{bmatrix} S_a \\ S_b \\ S_c \end{bmatrix} = \frac{\lambda}{2} \begin{bmatrix} \sin\omega_0 t \\ \sin(\omega_0 t - 120^\circ) \\ \sin(\omega_0 t + 120^\circ) \end{bmatrix} \quad (4)$$

Where λ is modulation depth of the SVG. From (3) ~ (4), we can concluded that:

$$\begin{aligned} i_d &= S_a i_{an} + S_b i_{bn} + S_c i_{cn} = \\ &= I_N \{ \cos[(n-1)\omega_0 t + n\varphi_1] (1 + 2\cos[(n-1)120^\circ]) \\ &\quad - \cos[(n+1)\omega_0 t + n\varphi_1] (1 + 2\cos[(n+1)120^\circ]) \} \end{aligned} \quad (5)$$

$$u_d = i_n |Z_c(\omega)| = U_N \{ \cos[(n-1)\omega_0 t + n\varphi_1] (1 + 2\cos[(n-1)120^\circ]) / (n-1) - \cos[(n+1)\omega_0 t + n\varphi_1] (1 + 2\cos[(n+1)120^\circ]) / (n+1) \} \tag{6}$$

Where: $I_N = \frac{3\lambda U_n}{4\sqrt{R^2 + (n\omega_0 L)^2}}, U_N = \frac{I_N}{\omega_0 C}$

From Equation (6), we can conclude that:

(1) DC voltage fluctuation frequency is only relative to the frequency of harmonic voltage.

(2) In case of the presence of $3k\pm 1$ order harmonic voltages, a $3k$ order harmonic component appears in the dc voltage. Figure 2~3 shows the simulation results ($k=1,2,3\dots$).

(3) $3k$ order harmonic voltage has no impact on dc voltage.

DC voltage fluctuation amplitude is relative to the harmonic voltage and modulation depth λ . When the harmonic voltage is constant, the greater λ is, the greater the fluctuation amplitude of dc voltage. Theoretically, dc voltage fluctuation can be suppressed by reducing λ . But reducing λ will affect waveform quality and increase the content of harmonic currents. And lower λ requires a higher dc voltage in the case of an certain rated capacity. In order to reduce the content of harmonic currents and improve the reliability of SVG, lower dc voltage with a higher λ is usually used.

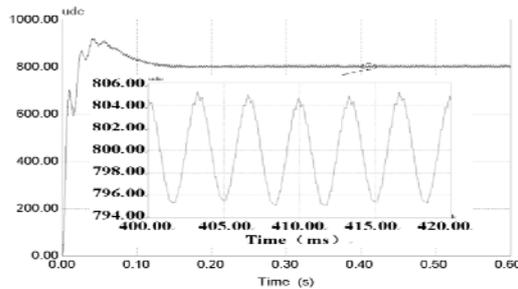


Figure 2. DC Voltage While Grid Contains Harmonic Voltage

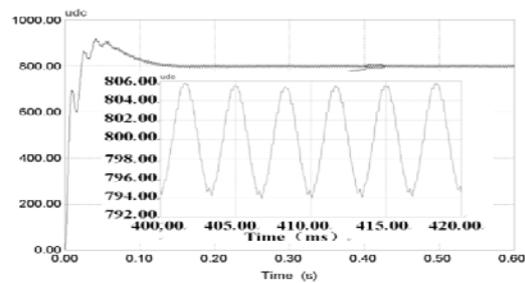


Figure 3. DC Voltage While Grid 30% 5 Order Contains 50% 7 Order Harmonic Voltage

2.2. Impact of Grid Negative Sequence Voltage

Negative sequence voltage content can be quantified using the following definition [3-6]:

$$K_- = \frac{U_-}{U_1} \times 100\% \tag{7}$$

Where U_- is the rms value of the negative sequence voltage. When the negative sequence voltage content is K_- , the negative sequence current flowing through the SVG is:

$$I_- = \frac{U_-}{X_-} = \frac{K_- U_1}{\sqrt{R^2 + (\omega_0 L)^2}} \tag{8}$$

Assumed that φ_2 is the phase angle of the fundamental negative sequence current, the negative sequence current is:

$$\begin{bmatrix} i_{a-} \\ i_{b-} \\ i_{c-} \end{bmatrix} = I_- \begin{bmatrix} \sin(\omega_0 t + \varphi_2) \\ \sin(\omega_0 t + \varphi_2 + 120^\circ) \\ \sin(\omega_0 t + \varphi_2 - 120^\circ) \end{bmatrix} \tag{9}$$

By considering only the fundamental frequency components, the switching function of the SVG converter can be simplified as Equation (4). From (4) and (9), we obtain:

$$i_d = S_a i_{a-} + S_b i_{b-} + S_c i_{c-} = I^- \cos(2\omega_0 t + \varphi_2) \tag{10}$$

$$u_d = i_d |Z_c(\omega)| = U^- \cos(2\omega_0 t + \varphi_2) / 2 \tag{11}$$

Where: $I^- = \frac{3\lambda U_-}{4\sqrt{R^2 + (\omega_0 L)^2}}, U^- = \frac{I^-}{\omega_0 C}$

From Equation (11), we can see that negative sequence voltages causes a second harmonic component in the dc voltage. Fluctuation amplitude is relative to the negative sequence voltage and the modulation depth λ . Figure 4 shows the simulation results.

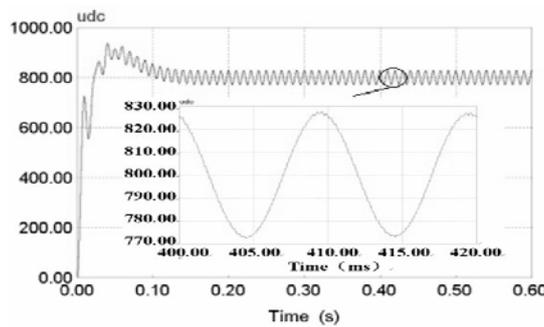


Figure 4. DC Voltage While Grid Contains 10% Negative Sequence Voltage

3. Influence of Non-ideal Grid Voltage on The AC Current
3.1. Influence of Grid Negative Sequence Voltage

The SVG ac current includes negative sequence current when the grid includes negative sequence voltage. The amplitude of the negative current can be calculated by Equation (8).

We assume that dc voltage is constant while analyzing the effect of the negative sequence voltage on the ac current. From Figure 5, we obtain that the ac current appears obvious unbalance when the grid voltages include 1% negative sequence voltage. Figure 6 shows that the simulation value of negative sequence current is close to the theoretical value.

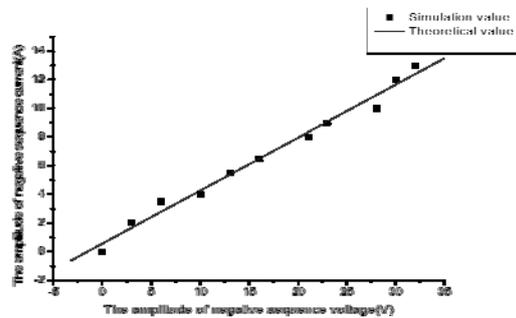


Figure 5. Output Current while Grid Contains 1% Negative Sequence Voltage

Figure 6. Relationship between the Amplitude of Negative Sequence Current and Negative Sequence Voltage

3.2. Influence of Grid Harmonic Voltage

Taking 5 order harmonic as an example. The ac current appears corresponding number harmonic current when grid voltage includes harmonic voltage. Equation (12) can calculate current amplitude [2].

$$I_5 = \frac{U_1 HR U_5}{\sqrt{R^2 + (5\omega_0 L)^2}} \tag{12}$$

Assume that dc voltage is constant. From Figure 7, we obtain that the output current appears obvious harmonic current when the grid voltage include 5% 5 order harmonic voltages. Figure 8 shows the simulation value of harmonic current closed to the theoretical value.

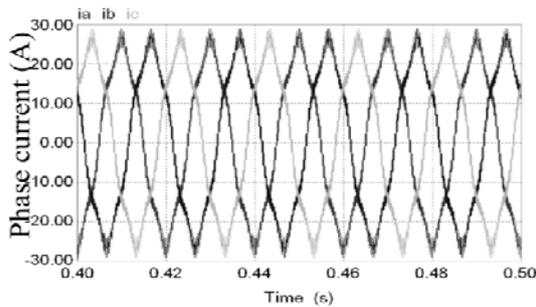


Figure 7. Output Current While Grid Contains 5% 5 Order Harmonic Voltage

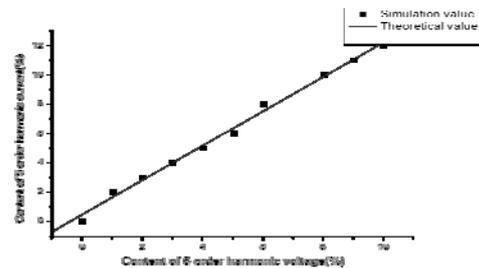


Figure 8. Relationship between 5 Order Harmonic Current and 5 Order Harmonic Voltage

4. Influence of the DC Voltage Fluctuation on the AC Current of SVG

A dc voltage with fluctuations can be expressed as:

$$U_{dc} = U_{dc0} [1 + k \sin(n\omega_0 t)] \tag{13}$$

Where U_{dc0} is the average voltage, k is fluctuation coefficient and $n\omega_0$ is fluctuation frequency. The output voltage of SVG can be expressed as:

$$\begin{bmatrix} U_{Ga} \\ U_{Gb} \\ U_{Gc} \end{bmatrix} = \frac{1}{2} \lambda U_{dc} \begin{bmatrix} \sin(\omega_0 t + \varphi) \\ \sin(\omega_0 t - 120^\circ + \varphi) \\ \sin(\omega_0 t + 120^\circ + \varphi) \end{bmatrix} \tag{14}$$

Substitute (13) into (14), we can obtain:

$$U_{Ga} = \lambda U_{dc0} \sin(\omega_0 t + \varphi) / 2 + \lambda k U_{dc0} \cos[(n-1)\omega_0 t - \varphi] / 4 - \lambda k U_{dc0} \cos[(n+1)\omega_0 t + \varphi] / 4 \tag{15}$$


$$U_{Gb} = \lambda U_{dc0} \sin(\omega_0 t + \varphi - 120^\circ) / 2 + \lambda k U_{dc0} \cos[(n-1)\omega_0 t - \varphi + 120^\circ] / 2 - \lambda k U_{dc0} \cos[(n+1)\omega_0 t + \varphi - 120^\circ] / 2 \tag{16}$$

$$U_{Gc} = \lambda U_{dc0} \sin(\omega_0 t + \varphi + 120^\circ) / 2 + \lambda k U_{dc0} \cos[(n-1)\omega_0 t - \varphi - 120^\circ] / 2 - \lambda k U_{dc0} \cos[(n+1)\omega_0 t + \varphi + 120^\circ] / 4 \tag{17}$$


From Equation (15)~(17) we can see that $n \pm 1$ order harmonic current appears in the ac current when dc voltage has n order harmonic fluctuations.

5. Control Strategy

To restrain the harmonic and negative sequence currents which are the consequence of harmonic and unbalanced grid voltage, a control strategy is proposed in this paper. The control block diagram is shown in Figure 9, it contains two major sections, one is the positive sequence control loop, the other is negative sequence control loop. The inputs of dual-loop control are the current generated by SVG and the grid voltage. The current is divided into positive sequence component and negative sequence component, which is fed into positive sequence control loop and negative sequence control loop. The sum of output signal of positive and negative sequence control loop can be used as voltage of impedance. The difference between grid voltage and sum can be used as modulation signal [7-10].

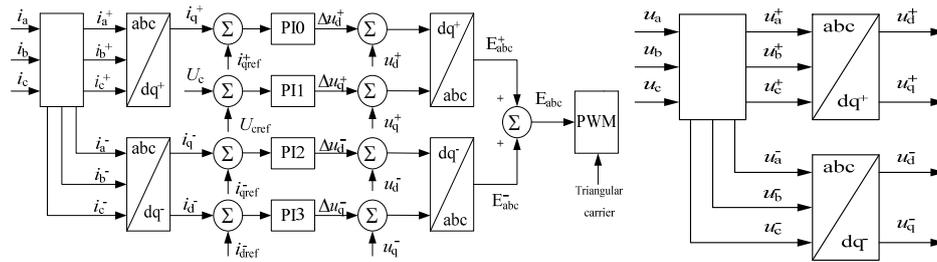

(a) The Control Block Diagram

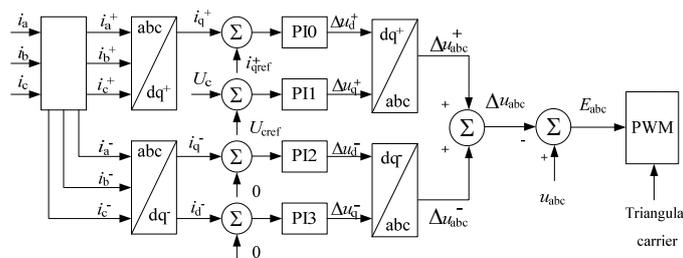

(b) A Simplified Control Block Diagram

Figure 9. The Block Diagram of Dual-loop Control

The positive sequence control loop consists of two loops, PI0 and PI1; the negative sequence control loop also consists of two loops, PI2 and PI3. PI0 and PI2 are to control reactive current. Their inputs are the difference between the reference reactive current and the reactive current generated by SVG. Their outputs can be used as the reactor voltage generated by reactive current. PI1 and PI3 are to control active current. Their outputs can be used as the reactor voltage generated by active current. The input of PI1 is the same to dc voltage control loop. The input of PI3 is the difference between the reference active current and the active current generated by SVG. The outputs of positive sequence control loop are the fundamental positive sequence voltage of reactance; the outputs of negative sequence control loop are the fundamental negative sequence voltage of reactance [12].

6. Simulation Results

In order to verify the validity of the analyses, the simulation results based on the SVG are shown in Figures as follows. The fully digital and dual-loop control strategy is used. Where $U_{dc}=800V$, $C=750\mu F$, $u_a = 311\cos\omega t$, the connected reactor value of the compensator is 4.5mH, the capacity of SVG is 20kvar.

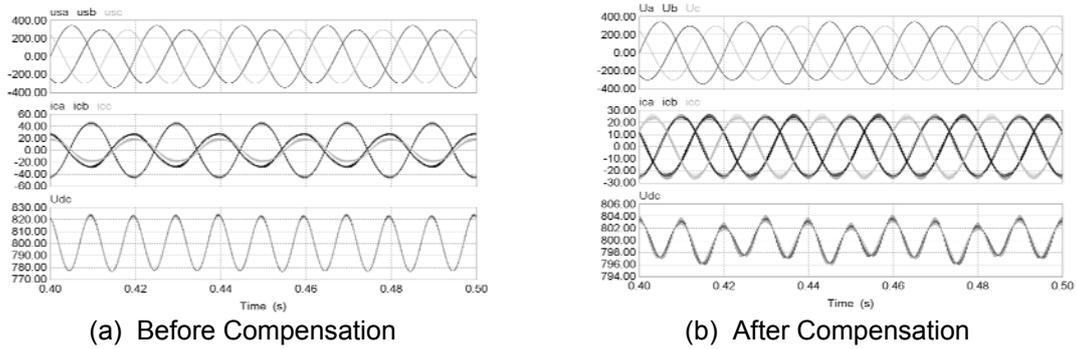


Figure 10. SVG Response to 10% Unbalanced Grid-Voltage

When the SVG responds to 10% unbalanced grid voltage before compensation, the simulation result is shown in Figure 10(a). Due to the adoption of control strategy, the fundamental negative sequence current of individual phase is lower than 0.5% after compensation, the simulation result is shown in Figure 10(b). The dc voltage is still steady around the set value and a 2 order harmonic component appears under the condition of unbalanced voltage.

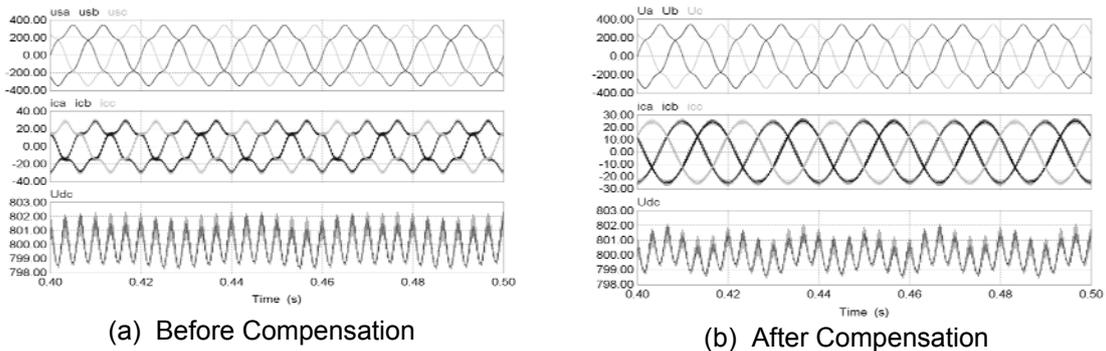


Figure 11. SVG Response to 10% 5 Order Harmonic Grid-Voltage

When the SVG responds to 10% 5 order harmonic grid voltage before compensation, the simulation result is shown in Figure 11(a). Due to the application of control strategy, the 5 order harmonic current are lower than 1% after compensation, the simulation result is shown in Figure 11(b). The dc voltage is still steady around the given value 800V.

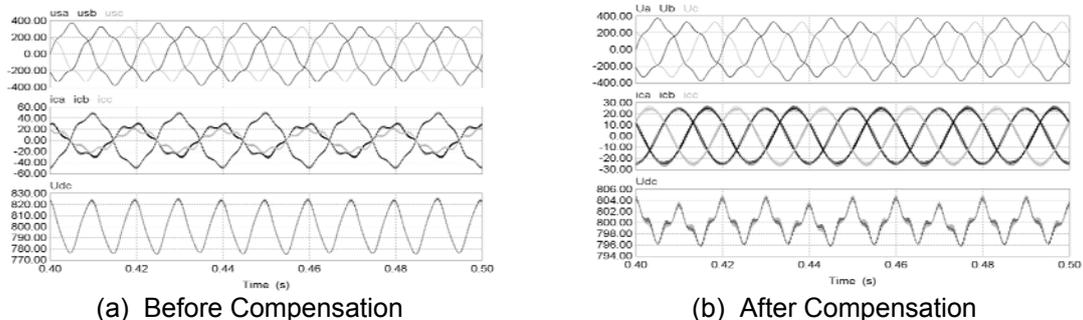


Figure 12. SVG Response to 10% Unbalanced Grid-Voltage and 10% 5 Order Harmonic Grid-Voltage

When the SVG responds to 10% unbalanced and 10% 5 order harmonic grid voltage before compensation, the simulation result is shown in Figure 12(a). Because of the dual-loop control strategy, the fundamental negative sequence and 5 order harmonic current of individual phase is lower than 1% after compensation, the simulation result is shown in Figure 12(b). The dc voltage remains stable at the reference value 800V.

7. Conclusion

In this paper, detailed analyses and design considerations are carried out to look into the influence of system voltage quality on SVG. The harmonic and negative components of grid voltage will cause the fluctuation of SVG dc voltage and also result in harmful components of ac current. A control strategy is proposed to suppress the influence of non-ideal grid voltage on the ac current. All these analyses can guide the practical applications; a reliable compensator will be designed. The simulation results verify the validity and feasibility of above analyses and conclusions.

References

- [1] RD Henderson, PJ Rose. Harmonics: The effects on power quality and transformers. *IEEE Transactions on Industrial Applications*. 1994; 30(3): 528-532.
- [2] Kale. M, Ozdemir. E. Harmonic and reactive power compensation with shunt active power filter under non-ideal mains voltage. *Electric Power Systems Research*. 2005; 74(3): 363-370.
- [3] Mohaddes M, Gole AM, Elez S. Steady state frequency response of STATCOM. *IEEE Transactions on Power Delivery*. 2001; 16(1): 18-23.
- [4] Li Xiaolu, Duan Xianzhong, He Yangzan. *Dynamic model of ASVG in unbalanced systems*. Proceedings of the CSEE. 1999; 19(9): 76-80.
- [5] Cavaliere CAC, Watanabe EH, Aredes M. *Multi-pulse statcom operation under unbalanced voltages*. Proceedings of the IEEE Power Engineering Society Winter Meeting, New York, USA. 2002: 567-572.
- [6] Sensarma PS, Padiyar KR, Ramanarayanan V. Analysis and performance evaluation of a distribution STATCOM for compensation voltage fluctuations. *IEEE Transactions on Power Delivery*. 2001; 16(2): 259-264.
- [7] Rong Fei, Luo An, Fan Qing. A novel voltage control method applied in STATCOM under unbalanced system. *Transactions of China Electrotechnical Society*. 2010; 25(3): 138-143.
- [8] Tang Jie, Luo An, Zhou Ke. Design and realization voltage control for static synchronous compensator. *Transactions of China Electrotechnical Society*. 2006; 21(8): 103-107.
- [9] Hochgraf C, Lasseter RH. Statcom controls for operation with unbalanced voltages. *IEEE Transactions on Power Delivery*. 1998, 13(2): 538-544.
- [10] Li Kuang, Liu Jinjun, Wang Zhaoan, et al. *Static Var generator control strategy for unbalanced systems in medium voltage applications*. Power Electronics Specialists Conference, 2004. PESC 04. 2004 IEEE 35th Annual, Aachen, Germany. 2004: 4257-4262.
- [11] Chen WL, Hsu YY. Direct output voltage control of a static synchronous compensator using current sensorless d-q vector-based power balancing scheme. *IEEE Transactions on Power Delivery*. 2003; 2(7- 12): 545-549.
- [12] Blazic B, Papic I. *STATCOM Control for Operation with Unbalanced Voltages[C]*. *Power Electronics and Motion Control Conference*. EPE-PEMC 2006.12th International, Portoroz, Slovenia. 2006: 1454-1459.